

Wall IE Modo Puente



El SCADA lee y escribe en los PLCs mientras el PC en fábrica lee una página WEB en el PC de control.

192.168.1.100



SCADA
STEP7
WEB Server
Etc.

Filtro WAN a LAN:

- 192.168.1.100 => 192.168.1.101 port 102
 - 192.168.1.100 => 192.168.1.102 port 102
 - 192.168.1.100 => 192.168.1.103 port 102
 - 192.168.1.100 => 192.168.1.104 port 102
 - 192.168.1.100 => 192.168.1.111 port 102
 - 192.168.1.100 => 192.168.1.112 port 102
 - 192.168.1.100 => 192.168.1.113 port 102
 - 192.168.1.100 => 192.168.1.114 port 102
- Filtro LAN a WAN:
192.168.1.110 => 192.168.1.100 port 80

¡El resto bloqueado!

Control




WAN/LAN: 192.168.1.200

Fábrica



WAN

LAN

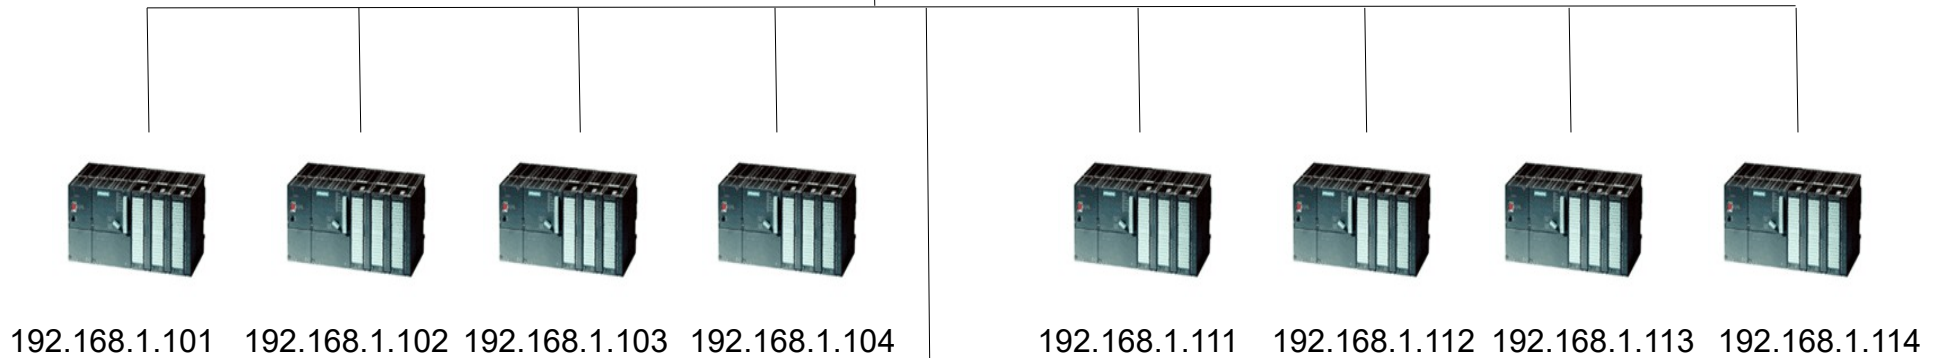

192.168.1.110